


ATTENTION: The connection of this radiator to a central heating system should be carried out by a suitably competent person who is familiar with current regulations.


**READ THIS GUIDE BEFORE
STARTING INSTALLATION**

Dimensions

Underside connections (1800mm only)

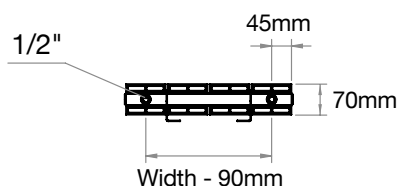

Flow diverter installation

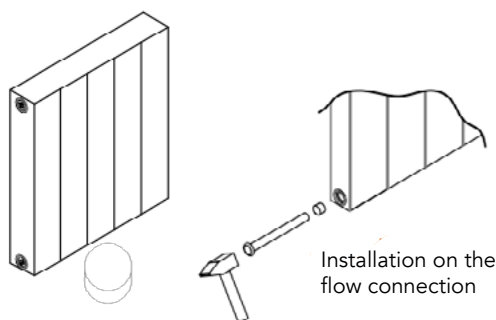

Sections	Flow Diverter Location
3 - 10	Between sections 2 & 3
10 - 20	Between sections 3 & 4

Flow diverter is included in the box, auxiliary equipment must be provided for assembly.


Water treatment

These products are for use on closed heating systems only; they are **NOT** suitable for installation on secondary HWS circuits. On completion of the installation the entire system **MUST** be thoroughly cleaned and flushed to remove debris/flux residues etc. If a chemical cleanser is used, it must be thoroughly flushed from the system. Following this, the system **MUST** be dosed with a good quality water treatment to prevent corrosion. System design, flushing and dosing must be in accordance with BS 5449: 1990, BS EN 12828: 2003 and BS 7593: 1992.

IMPORTANT: Failure to observe these requirements will render the guarantee on the product void. Corrosion inhibitor must be used in accordance with the manufacturer's instructions and recommendations and should take into account the particular metals within the system.

Dimensions

Bracket positions - reverse side

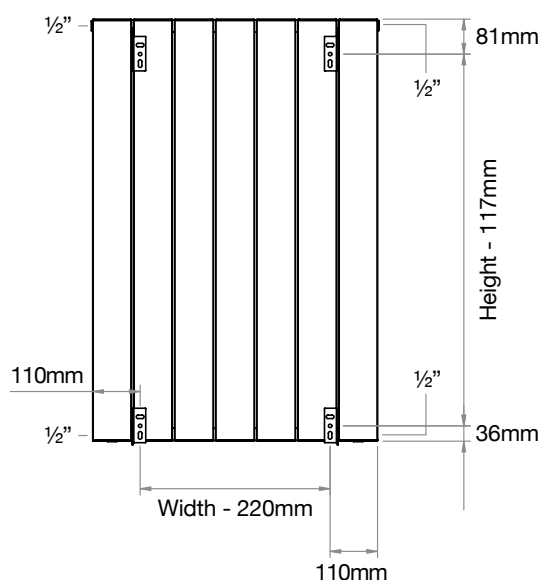

Side view

